View NSN Online: https://aerobasegroup.com/nsn/8010-00-490-7651

Product ID:794-800 MSDS Date:01/01/1985

FSC:8010

NIIN:00-490-7651

MSDS Number: BFBHN === Responsible Party ===

Company Name: AMERON INDUSTRIAL COATINGS DIVISION

Address: 201 N BERRY ST

City:BREA State:CA

ZIP:92621-3904 Country:US CAGE:09869

=== Contractor Identification === Company Name: AMERON INDU STRIAL COATINGS DIVISION Address: 201 N BERRY ST

Box:City:BREA

State:CA

ZIP:92621-3904 Country:US

Phone:714-529-4597

CAGE:09869

======= Composition/Information on Ingredients ========

Ingred Name: ISOPROPYL ALCOHOL (SARA III)

CAS:67-63-0

RTECS #:NT8050000 Fraction by Wt: 4.5%

OSHA PEL:400 PPM/500 STEL ACGIH TLV:400 PPM/500STEL;9192

Ingred Name: METHYL ETHYL KETONE (2-BUTANONE) (MEK) (SARA III)

CAS:78-93-3

RTECS #:EL6475000 Fraction by Wt: 30.0%


OSHA PEL:200 PPM/300 STEL

ACGIH TLV:

200 PPM/300STEL 9192 EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS
Ingred Name:TOLUENE (SARA III) CAS:108-88-3 RTECS #:XS5250000 Fraction by Wt: 14.3% OSHA PEL:200 PPM/150 STEL ACGIH TLV:50 PPM; 9293 EPA Rpt Qty:1000 LBS DOT Rpt Qty:1000 LBS
Ingred Name:CYCLOHEXANONE (SARA III) CAS:108-94-1 RTECS #:GW1050000 Fraction by Wt: 26.2% OSHA PEL:S, 50 PPM ACGIH TLV:S, 25 PPM; 9293 EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS
========== Hazards Identification ===========
Effects of Overexposure:INHALE:ANESTHETIC,IRRITATION OF RESPIRTORY TRACT,ACUTE NERVOUS SYSTEM DEPRESSION CHARACTERIZED BY
======================================
First Aid:INCASE OF CONTACT, FLUSH SKIN AND EYES WITH PLENTY OF WATER WHILE REMOVING CONTAMINATED CLOTHING. IF INHALED, REMOVE TO FRESH AIR. CALL A PHYSICIAN SYMPTOMS PERSIST
======================================
Flash Point:45F,7C TCC Lower Limits:1.0 Extinguishing Media:CAR BON DIOXIDE/DRY CHEMICAL-SMALL;POLYMER
FOAM-LARGE FIRE Fire Fighting Procedures:SELF-CONTAINED BREATHING APPARATUS AVAILABLE
FOR FIRMEN Unusual Fire/Explosion Hazard:CLOSED CONTAINERS EXPOSED TO HEAT MAY EXPLODE DUE TO PRESSURE BUILD UP

========== Accidental Release Measures ==========

Spill Release Procedures:REMOVE ALL SOURCES OF IGNITION(FLAMES,HOT SURFACES,AND ELECTRICAL STATIC,OR FRICTIONAL SPARKS)AVOID BREATHING VAPORS.VENTILATE AREA.REMOVE WITH INER

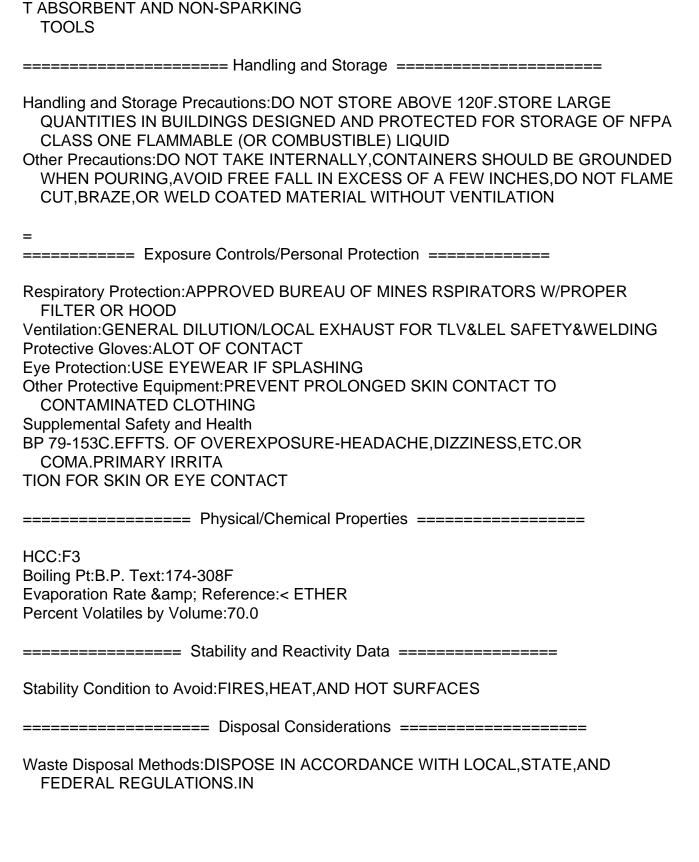

CINERATE IN APPROVED FACILITY.DO NOT INCINERATE CLOSED CONTAINERS

Disclaimer (provided with this information by the compiling agencies): This information is formulated for use by elements of the Department of Defense. The United States of America in no manner whatsoever, expressly or implied, warrants this information to be accurate and disclaims all liability for its use. Any person utilizing this document should seek competent professional advice to verify and assume responsibility for the suitability of this information to their particular situation.